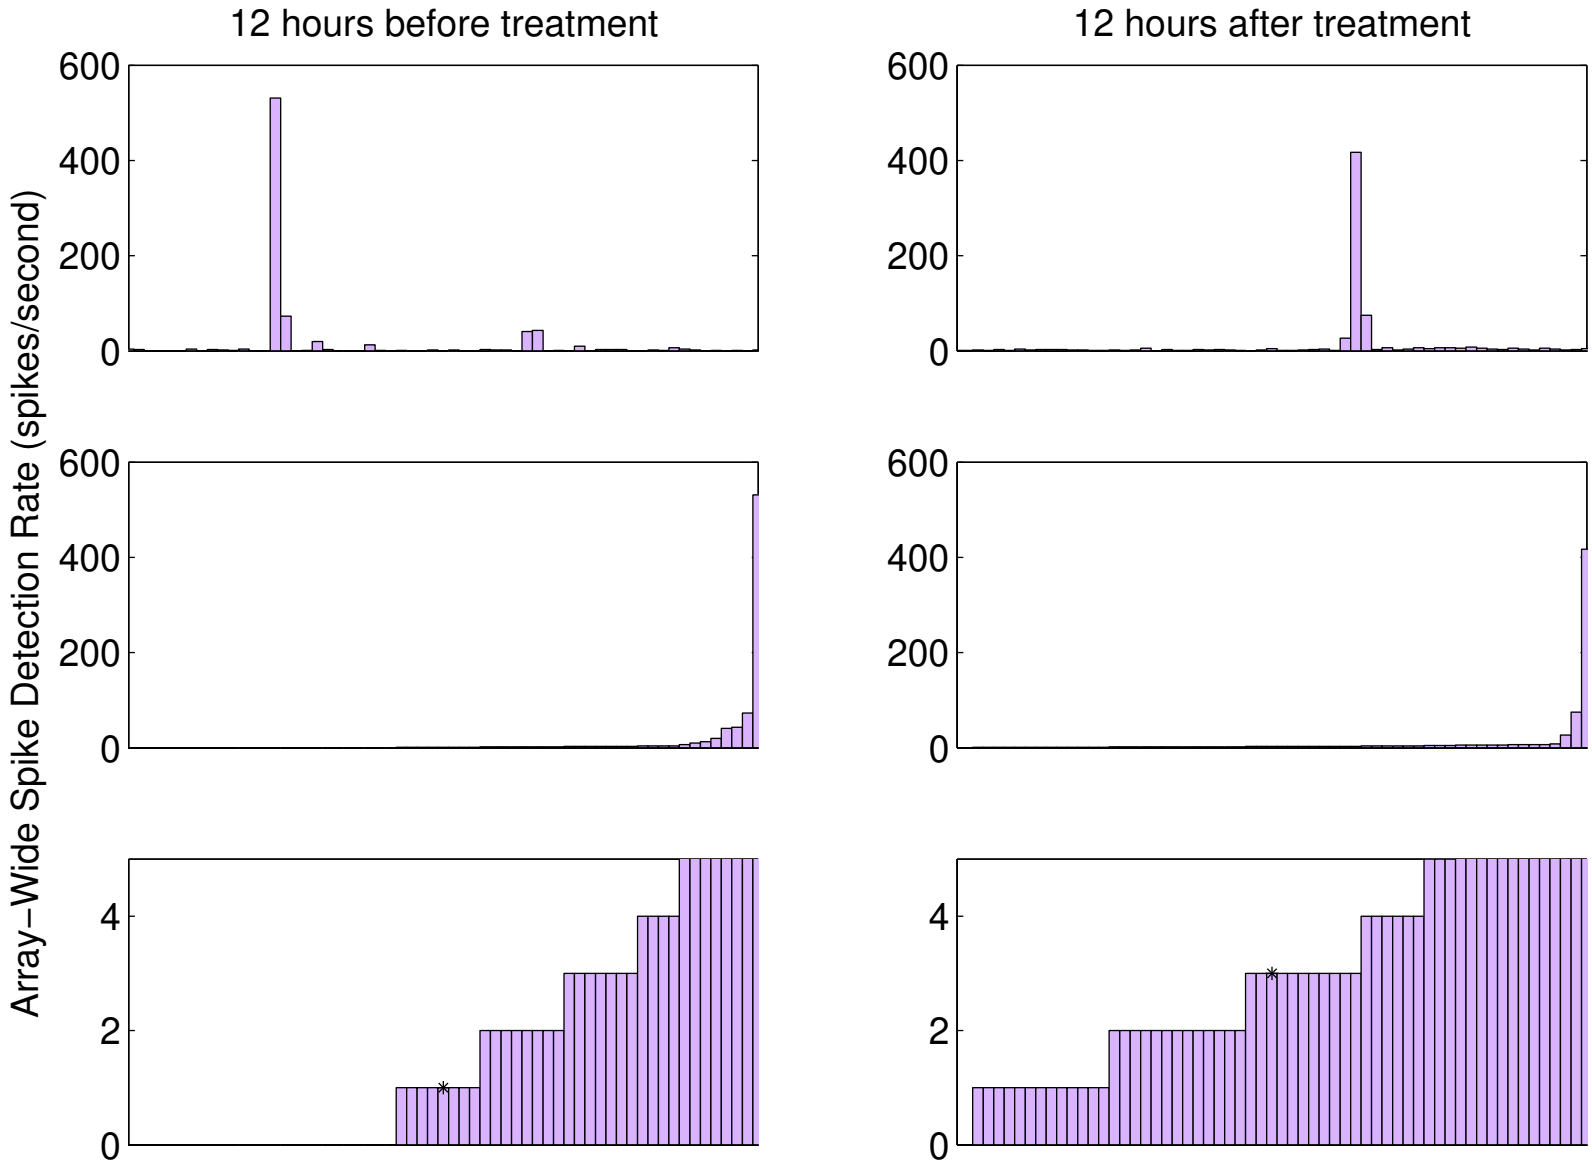
12 hours before treatment
12 hours after treatment
Array−Wide Spike Detection Rate (spikes/second)
600
400
200
0
600
400
200
0
600
400
200
0
4
2
0
4
2
0